

Temperature Probes for Heat Meters

Basic types 902428/20 and 902428/70



Operating Manual

90242820T90Z001K000

V1.00/EN/00709221



1	Safety information	4
2	General information	5
2.1	Object of these instructions and purpose of application	6
2.2	Identification marking	6
3	Technical data	7
4	Installation	8
5	Maintenance	10
6	Declaration of conformity	11
7	China RoHS	17

1 Safety information

General

This manual contains information that must be observed in the interest of your own safety and to avoid material damage. This information is supported by symbols which are used in this manual as indicated.

Please read this manual before starting up the device. Store this manual in a place that is accessible to all users at all times.

If difficulties occur during startup, please do not intervene in any way that could jeopardize your warranty rights!

Warning symbols



WARNING!

This symbol in connection with the signal word indicates that **personal injury** may occur if the respective precautionary measures are not carried out.



READ THE DOCUMENTATION!

This symbol, which is attached to the device, indicates that the associated **documentation for the device** must be **observed**. This is necessary to identify the nature of the potential hazard, and to take measures to prevent it.

Note symbols



NOTE!

This symbol refers to **important information** about the product, its handling, or additional benefits.



DISPOSAL!

At the end of its service life, the device and any batteries present do not belong in the trash! Please ensure that they are **disposed of** properly and in an **environmentally friendly** manner.

2 General information

The following standards and directives apply to the use of pairs of temperature probes for measuring the inflow and outflow temperature in a heat exchanger system:

- Product standard DIN EN 1434
- Product standard DIN EN 60751
- Directive 2014/32/EU, Annex I and MI-004
- TR-K7.1, TR-K7.2, TR-K8 and TR-K9
- German Weights and Measures Act (MessEG)
- German Weights and Measures Directive (MessEV)

Specifications for electrical installations must be observed.

All installation and maintenance work must be performed by specialist staff trained for this task.

All notes listed in the installation instructions must be observed.

Identification markings and metrology-relevant safety markings/main stamps must not be damaged or removed – otherwise the temperature probes are no longer admissible for use!

Route the measurement signal lines so that they are at least 50 mm away from other lines, such as grid supply lines and data transmission lines. We recommend installing lines and computer units 300 mm away from strong electromagnetic fields, e.g. from frequency-controlled pumps and high-voltage power lines.

To protect against damage and pollutants, the temperature probes must not be removed from their packaging until immediately before installation.

Do not wind, bend, extend, or shorten the temperature probe lines.

When connecting to a computer unit, always connect the temperature probes first before connecting the volume measuring unit.



WARNING!

Risk of burns!

The installation process must be carried out by trained personnel.

When using water additives (corrosion protection, etc.), the operator must make sure there is sufficient corrosion resistance before installing the temperature probe.

With direct mounting, the temperature probe is immersed in the pipeline without any additional immersion sleeve. During dismounting, always make sure that hot medium does not escape from the pipeline.

- ▶ Drain the pipeline system or seal off the temperature probe's installation location to relieve pressure.
-

2 General information

2.1 Object of these instructions and purpose of application

The standard DIN EN 1434 describes the requirements for heat meters and their sub-components. When combining sub-components (flow sensor, pair of temperature probes, computer unit) to form a heat meter, the standard prescribes platinum RTD temperature probes according to the standard DIN EN 60751 because these probes have sufficient measurement stability, accuracy, and interchangeability.

These days, the latest heat meters use various nominal values on the computer unit side (resistance value at 0 °C). The nominal values are normally 100 Ω (Pt100), 500 Ω (Pt500), and 1000 Ω (Pt1000).

The RTD temperature probes from the type series 902428/20 and 902428/70 for direct mounting are type-tested according to the European Measuring Instruments Directive 2014/32/EU (MID) including Annexes I and MI-004. The paired temperature probes are suitable for being connected to a computer unit of a heat meter and measuring the difference between the inflow and outflow temperature of a heat exchanger system.

The temperature probes are made up of a corrosion-resistant protection fitting. The connecting cable is connected to the temperature probe so that it cannot be disconnected.

In order to meet the metrological requirements of the European Measuring Instruments Directive 2014/32/EU (MID) and the Annex MI-004, the temperature probes are calibrated at three temperatures and paired according to a special mathematical process in order to comply with the tolerance for the temperature difference. The lower limit for the temperature difference is 3 K.

2.2 Identification marking

Each temperature probe pair is equipped with a nameplate containing the following information:

- CE identification marking with ID codes for the notified bodies appointed to certify module D (production quality assurance)
- Metrology identification marking, including the two digits for the year in which the identification marking was created
- Logo for the owner of the type examination certificate
- Type examination certificate number
- Pair number/ID
- Manufacturing date (year/calendar week)
- Manufacturing location (in-house code)
- Type number
- Admissible measuring range (temperature, temperature difference)
- Maximum pressure stage
- Nominal value
- Manufacturer's address

The inflow and outflow probes are distinguished by colored identification markings on the temperature probe's cable (red: inflow, blue: outflow) or using an identification marking on the nameplate (V = inflow, R = outflow).

3 Technical data

Temperature range 902428/20 902428/70	0 to 180 °C 0 to 150 °C
Protection type	IP65 (as delivered condition) In heat applications, it must be ensured that the dew point is not reached or undershot.
Temperature difference Minimum 902428/20 and 902428/70 Maximum 902428/20 902428/70	3 K 180 K 150 K
Maximum pressure	PS25 for a water flow velocity of 2 m/s
Electrical connection	Two-wire, four-wire
Maximum measuring current	The maximum measuring current is calculated using the maximum admissible power loss of 5 mW. Depending on the nominal values, this results in the following effective current values: Pt100: 1783 µA Pt500: 797 µA Pt1000: 564 µA
Response times 902428/20 902428/70	$t_{0,5} \leq 2.0 \text{ s}; t_{0,9} \leq 5.0 \text{ s}$ $t_{0,5} \leq 2.0 \text{ s}; t_{0,9} \leq 5.0 \text{ s}$
Minimum immersion depth	15 mm
Nominal value	Pt100, Pt500, Pt1000 (see identification marking for temperature probes)
Tolerance	Class B according to DIN EN 60751; restricted tolerances optional When using two-wire technology, the display will be systematically higher due to the line resistance (see maximum connection length according to DIN EN 1434).

4 Installation

If the pair of temperature probes is connected to a computer unit, make sure that the probe's nominal value matches that of the processing computer unit.

Furthermore, make sure that the installation location is deep enough to prevent damage to the tip of the probe when screwing in.

The temperature probe must be installed in the pipeline so that a sufficient immersion depth is guaranteed which is greater than the minimum immersion depth in all cases.

During installation, the connecting cable must not be shortened or extended as this would impair compliance with the tolerance (for two-wire technology).

To prevent an inductive effect, the connecting cable should not be wound.

The connecting cable must not be laid alongside or wrapped around hot pipes because the line resistance and its temperature dependence are considered in the measurement result for temperature probes using two-wire technology.


Following successful mounting, the temperature probes must be secured against manipulation with a seal. The sealing hole in the fastening screw or nameplate is intended for this purpose. The sealing set is available as part no. 00650727.



NOTE!

The following specifications apply for Germany according to the technical directives TR-K8 and TR-K9: For heat/cold meters with nominal flow rates less than or equal to $q_p 6 \text{ m}^3/\text{h}$, the temperature probe must only be installed with direct immersion when installing the section of the pipeline in the measuring point area with nominal pressures less than or equal to 16 bar.

The installation locations must be implemented according to the DIN EN 1434-2:2015 standard (see the figure below). The mounting must be implemented according to the mounting specifications. Make sure that the seal and sealing surface in the installation location are undamaged, clean, and dry.

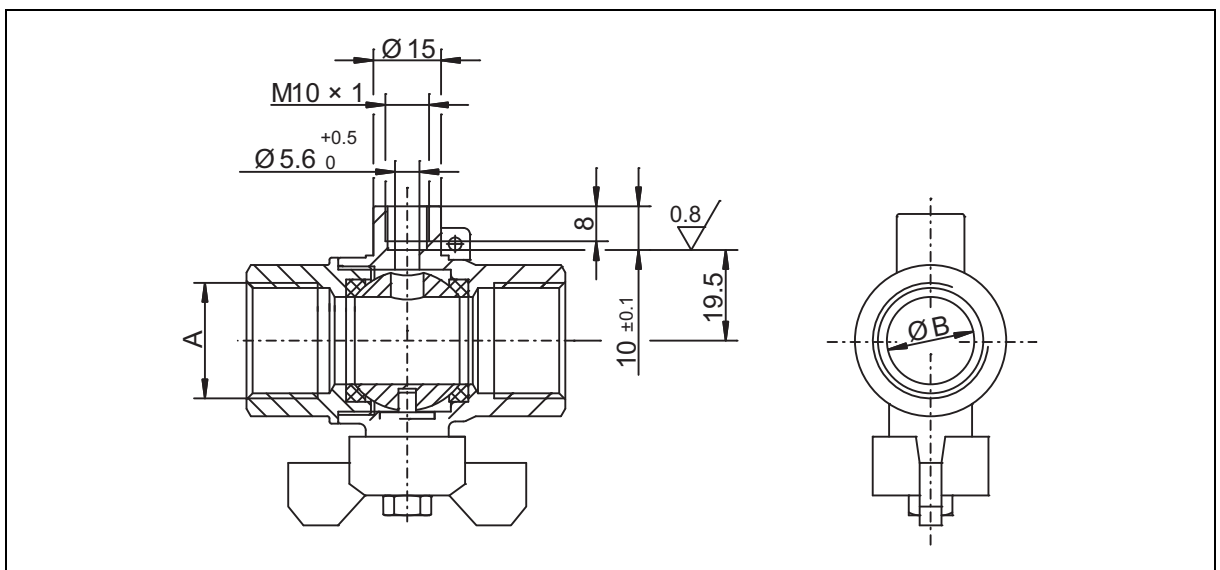

Thread size A	Inner diameter B
G 1/2 B	18.5 mm
G 3/4 B	24 mm
G 1 B	30.5 mm
G 1 1/4 B	39 mm
G 1 1/2 B	45 mm

4 Installation



NOTE!


The minimum immersion depth for the temperature probes is 15 mm.



NOTE!

Recommended tightening torques 6 to 10 Nm (in installation locations according to DIN EN 1434-2:2015)

In order to achieve an optimum measurement result, we recommend the following insertion lengths for the temperature probe depending on the nominal diameter of the ball valve:

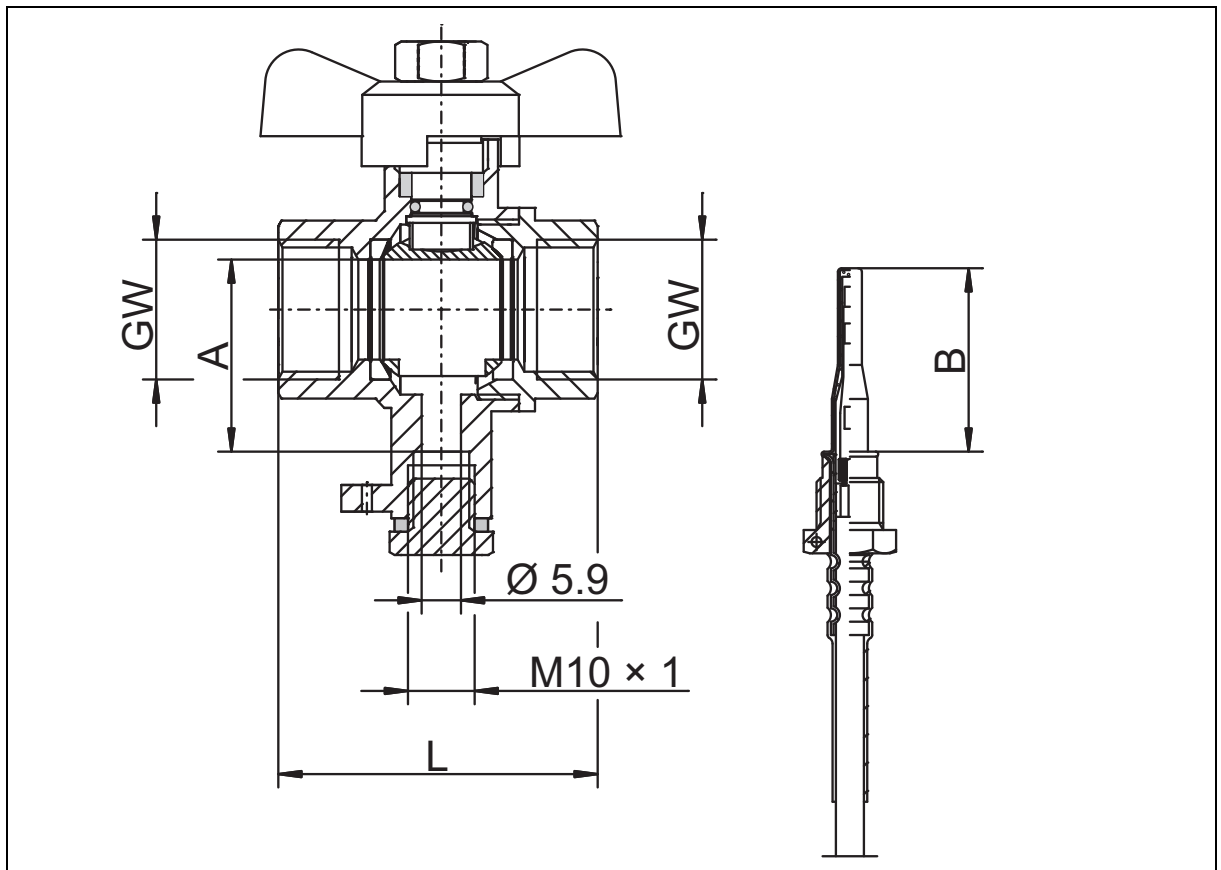

Insertion length, ball valve			Insertion length, sensor
GW	A	DN	B
1/2"	29.0 mm	15	27.5 mm
3/4"	31.0 mm	20	27.5 mm
1"	36.5 mm	25	27.5 mm
1 1/4"	46.0 mm	32	38.0 mm
1 1/2"	55.0 mm	40	38.0 mm
2"	65.4 mm	50	60.0 mm



NOTE!

The dimensions specified only apply to ball valves of JUMO GmbH & Co. KG.

5 Maintenance

In order to maintain temperature stability, a metrological inspection must be carried out when the national calibration period has elapsed to check that the maximum permissible error (MPE) is observed.

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

EU-Konformitätserklärung

EU declaration of conformity / Déclaration UE de conformité

Dokument-Nr. <i>Document No. / Document n°.</i>	CE 431	
Hersteller <i>Manufacturer / Etabli par</i>	JUMO GmbH & Co. KG	
Anschrift <i>Address / Adresse</i>	Moritz-Juchheim-Straße 1, 36039 Fulda, Germany	
Produkt <i>Product / Produit</i>		
Name <i>Name / Nom</i>	Typ <i>Type / Type</i>	Typenblatt-Nr. <i>Data sheet no. / N° Document d'identification</i>
JUMO HEATtemp - RTD - Type DS	902428/20	902425

Wir erklären in alleiniger Verantwortung, dass das bezeichnete Produkt die Anforderungen der Europäischen Richtlinien erfüllt.

We hereby declare in sole responsibility that the designated product fulfills the requirements of the European Directives.

Nous déclarons sous notre seule responsabilité que le produit remplit les Directives Européennes.

Richtlinie 1

Directive / Directive

Name MID
Name / Nom

Fundstelle 2014/32/EU
Reference / Référence

Bemerkung Mod. B+D
Comment / Remarque

Datum der Erstanbringung des CE-Zeichens auf dem Produkt 2006

Date of first application of the CE mark to the product / Date de 1ère application du sigle sur le produit

Dokument-Nr.
Document No. / Document n°.

CE 431

EU-Konformitätserklärung

Seite: 1 von 3

6 Declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

Gültig für Typ

Valid for Type / Valable pour le type

902428/20

EU-Baumusterprüfbescheinigung 1.1

EU type examination certificate / Certificat d'examen de type UE

Fundstelle

Reference / Référence

DE-06-MI004-PTB012

Benannte Stelle

Notified Body / Organisme notifié

Physikalisch-Technische-Bundesanstalt (PTB)

Kennnummer

Identification no. / N° d'identification

0102

Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

Fundstelle

Reference / Référence

Ausgabe

Edition / Édition

Bemerkung

Comment / Remarque

EN 1434-1

2015

EN 1434-2

2015

EN 1434-4

2015

EN 1434-5

2015

EN 60751

2008

Gültig für Typ

Valid for Type / Valable pour le type

902428/20

Anerkannte Qualitätssicherungssysteme der Produktion

Recognized quality assurance systems of production / Systèmes de qualité reconnus de production

Benannte Stelle

Notified Body / Organisme notifié

Physikalisch-Technische-Bundesanstalt (PTB)

Kennnummer

Identification no. / N° d'identification

0102

Dokument-Nr.
Document No. / Document n°.

CE 431

EU-Konformitätserklärung

Seite: 2 von 3

6 Declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

Allgemeine Bemerkungen

General remarks / Observations générales

Annex II Module D of Directive 2014/32/EU of the European Parliament and of the Council of 26 February 2014 on measuring instruments (ABl. EG Nr. L 180)

Physikalisch-Technische Bundesanstalt Braunschweig, Body No.: 0102

Conformity assessment body, Assessment of QM-Systems of manufacturers of measuring instruments

Certificate No.: DE-M-AQ-PTB002

Aussteller

Issued by / Etabli par

JUMO GmbH & Co. KG

Ort, Datum

Place, date / Lieu, date

Fulda, 2018-07-03

Rechtsverbindliche Unterschriften

Legally binding signatures /

Signatures juridiquement valable

Bereichsleiter Vertrieb Inland / Globales
Produkt- und Branchenmanagement
ppa. Dimitrios Charisiadis

Qualitätsbeauftragter und Leiter Qualitätswesen
i. V. Harald Gienger

Dokument-Nr.
Document No. / Document n°.

CE 431

EU-Konformitätserklärung

Seite: 3 von 3

6 Declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

EU-Konformitätserklärung

EU declaration of conformity / Déclaration UE de conformité

Dokument-Nr. <i>Document No. / Document n°.</i>	CE 424	
Hersteller <i>Manufacturer / Etabli par</i>	JUMO GmbH & Co. KG	
Anschrift <i>Address / Adresse</i>	Moritz-Juchheim-Straße 1, 36039 Fulda, Germany	
Produkt <i>Product / Produit</i>		
Name <i>Name / Nom</i>	Typ <i>Type / Type</i>	Typenblatt-Nr. <i>Data sheet no. / N° Document d'identification</i>
JUMO HEATtemp - RTD - Type DS	902428/70	902425

Wir erklären in alleiniger Verantwortung, dass das bezeichnete Produkt die Anforderungen der Europäischen Richtlinien erfüllt.

We hereby declare in sole responsibility that the designated product fulfills the requirements of the European Directives.

Nous déclarons sous notre seule responsabilité que le produit remplit les Directives Européennes.

Richtlinie 1

Directive / Directive

Name MID
Name / Nom

Fundstelle 2014/32/EU
Reference / Référence

Bemerkung Mod. B+D
Comment / Remarque

Datum der Erstanbringung des CE-Zeichens auf dem Produkt 2006

Date of first application of the CE mark to the product / Date de 1ère application du sigle sur le produit

Dokument-Nr.
Document No. / Document n°.

CE 424

EU-Konformitätserklärung

Seite: 1 von 3

6 Declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

Gültig für Typ

Valid for Type / Valable pour le type

902428/70

EU-Baumusterprüfbescheinigung 1.1

EU type examination certificate / Certificat d'examen de type UE

Fundstelle

DE-06-MI004-PTB010

Reference / Référence

Benannte Stelle

Physikalisch-Technische-Bundesanstalt (PTB)

Notified Body / Organisme notifié

Kennnummer

0102

Identification no. / N° d'identification

Angewendete Normen/Spezifikationen

Standards/Specifications applied / Normes/Spécifications appliquées

Fundstelle

Ausgabe

Bemerkung

Reference / Référence

Edition / Édition

Comment / Remarque

EN 1434-1

2015

EN 1434-2

2015

EN 1434-4

2015

EN 1434-5

2015

EN 60751

2008

Anerkannte Qualitätssicherungssysteme der Produktion

Recognized quality assurance systems of production / Systèmes de qualité reconnus de production

Benannte Stelle

Kennnummer

Notified Body / Organisme notifié

Identification no. / N° d'identification

Physikalisch-Technische-Bundesanstalt (PTB)

0102

Allgemeine Bemerkungen

General remarks / Observations générales

Annex II Module D of Directive 2014/32/EU of the European Parliament and of the Council of 26 February 2014 on measuring instruments (ABI. EG Nr. L 180)

Physikalisch-Technische Bundesanstalt Braunschweig, Body No.: 0102

Conformity assessment body, Assessment of QM-Systems of manufacturers of measuring instruments

Certificate No.: DE-M-AQ-PTB002

Dokument-Nr.

CE 424

EU-Konformitätserklärung

Seite: 2 von 3

Document No. / Document n°.

6 Declaration of conformity

JUMO GmbH & Co. KG

Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Tel.: +49 661 6003-0
Fax: +49 661 6003-500

E-Mail: mail@jumo.net
Internet: www.jumo.net



More than **sensors + automation**

Aussteller

Issued by / Etabli par

JUMO GmbH & Co. KG

Ort, Datum

Place, date / Lieu, date

Fulda, 2018-07-03

Rechtsverbindliche Unterschriften

Legally binding signatures /

Signatures juridiquement valable

Bereichsleiter Vertrieb Inland / Globales
Produkt- und Branchenmanagement
ppa. Dimitrios Charisiadis

Qualitätsbeauftragter und Leiter Qualitätswesen
i. V. Harald Gienger

Dokument-Nr.
Document No. / Document n°.

CE 424

EU-Konformitätserklärung

Seite: 3 von 3

						
产品组别 Product group: 902428	产品中有害物质的名称及含量 China EEP Hazardous Substances Information					
部件名称 Component Name						
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr(VI))	多溴联苯 (PBB)	多溴二苯醚 (PBDE)
外壳 Housing (Gehäuse)	○	○	○	○	○	○
过程连接 Process connection (Prozessanschluss)	X	○	○	○	○	○
螺母 Nuts (Mutter)	○	○	○	○	○	○
螺栓 Screw (Schraube)	○	○	○	○	○	○
<p>本表格依据SJ/T 11364的规定编制。 This table is prepared in accordance with the provisions SJ/T 11364. ○ : 表示该有害物质在该部件所有均质材料中的含量均在GB/T 26572规定的限量要求以下。 Indicate the hazardous substances in all homogeneous materials' for the part is below the limit of the GB/T 26572. × : 表示该有害物质至少在该部件的某一均质材料中的含量超出GB/T 26572规定的限量要求。 Indicate the hazardous substances in at least one homogeneous materials' of the part is exceeded the limit of the GB/T 26572.</p>						

7 China RoHS



JUMO GmbH & Co. KG

Street address:
Moritz-Juchheim-Straße 1
36039 Fulda, Germany

Delivery address:
Mackenrodtstraße 14
36039 Fulda, Germany

Postal address:
36035 Fulda, Germany

Phone: +49 661 6003-0
Fax: +49 661 6003-607
Email: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow, Essex, CM20 2DY, UK

Phone: +44 1279 63 55 33
Fax: +44 1279 62 50 29
Email: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

6733 Myers Road
East Syracuse, NY 13057, USA

Phone: +1 315 437 5866
Fax: +1 315 437 5860
Email: info.us@jumo.net
Internet: www.jumousa.com

